

# YUVAENGINEERS

Transforming Young Engineers for Better Tomorrow

## A Voltage Controller for Three-Phase DSTATCOM to Compensate AC and DC Loads for Quick Response



**M Lakshminarayana**  
M.Tech,  
(Electrical Power Systems)



**Kurivindala Ravi**  
Assistant Professor,  
Department of EEE,  
Sreenidhi Institute of Science Technology,  
Hyderabad, Telangana, India.



**Medi Murali Krishna**  
Assistant Professor,  
Department of EEE,  
Adams Engineering College,  
Paloncha, Telangana, India.



**Chilaka Udaya Kumar**  
Assistant Professor,  
Department of EEE,  
Anubose Institute of Technology,  
Paloncha, Telangana, India.

### Abstract:

In this paper, DSTATCOM topology for compensating ac loads in the three-phase, four-wire systems as well as supplying dc loads from its dc link and the transient responses of the distribution static compensator (DSTATCOM) for different types of controllers are studied. This transient response of DSTATCOM is very important while compensating rapidly varying unbalanced and nonlinear loads. Any change in the load affects the dc-link voltage directly. The sudden removal of load would result in an increase in the dc-link voltage above the reference value, whereas a sudden increase in load would reduce the dc-link voltage below its reference value. The proper operation of DSTATCOM requires variation of the dc-link voltage within the prescribed limits. Conventionally, a proportional-integral (PI) controller is used to maintain the dc-link voltage to the reference value. It uses deviation of the capacitor voltage from its reference value as its input. However, the transient response of the conventional PI dc-link voltage controller is slow.

In this paper, a fast-acting dc-link voltage controller based on the energy of a dc-link capacitor is proposed. This paper reveals that the fast-acting dc-link voltage controller can regulate the capacitor voltage within a half cycle period. Owing to its good transient performance, for quick response, it is preferred over the conventional dc link voltage controller. Mathematical equations are given to compute the gains of the conventional controller based on fast-acting dc-link voltage controllers to achieve similar fast transient response. The detailed simulation and experimental studies are carried out to validate the proposed controller.

### Index Terms:

DC-link voltage controller, distribution static compensator (DSTATCOM), fast transient response, harmonics, load compensation, power factor, power quality (PQ), unbalance, voltage-source inverter (VSI).

# YUVAENGINEERS

Transforming Young Engineers for Better Tomorrow

## I. INTRODUCTION:

The proliferation of power-electronics-based equipment, nonlinear and unbalanced loads, has aggravated the power-quality (PQ) problems in the power distribution network. They cause excessive neutral currents, overheating of electrical apparatus, poor power factor, voltage distortion, high levels of neutral-to-ground voltage, and interference with communication systems. The shunt-connected custom power device, called the distribution static compensator (DSTATCOM), injects current at the point of common coupling (PCC) so that harmonic filtering, power factor correction, and load balancing can be achieved. The DSTATCOM consists of a current controlled voltage-source inverter (VSI) which injects current at the PCC through the interface inductor. The operation of VSI is supported by a dc storage capacitor with proper dc voltage across it. One important aspect of the compensation is the extraction of reference currents. However, due to the simplicity in formulation and no confusion regarding the definition of powers, the control algorithm based on instantaneous symmetrical component theory is preferred. Based on this algorithm, the compensator reference currents ( $i_{fa}^*$ ,  $i_{fb}^*$ ,  $i_{fc}^*$ ) are given as follows:

$$\left. \begin{aligned} i_{fa}^* &= i_{la} - \frac{v_{sa} + \gamma(v_{sb} - v_{sc})}{\sum_{i=a,b,c} v_{si}^2} (P_{lavg} + P_{dc}) \\ i_{fb}^* &= i_{lb} - \frac{v_{sb} + \gamma(v_{sc} - v_{sa})}{\sum_{i=a,b,c} v_{si}^2} (P_{lavg} + P_{dc}) \\ i_{fc}^* &= i_{lc} - \frac{v_{sc} + \gamma(v_{sa} - v_{sb})}{\sum_{i=a,b,c} v_{si}^2} (P_{lavg} + P_{dc}) \end{aligned} \right\} (1)$$

Where,  $\gamma = \tan\phi/\sqrt{3}$ ,  $\phi$  is the desired phase angle between the supply voltages and compensated source currents in the respective phases. For unity power factor operation,  $\phi = 0$ , thus  $\gamma = 0$ . The term  $P_{lavg}$  is the dc or average value of the load power. The term  $P_{dc}$  in (1) accounts for the losses in the VSI without any dc loads in its dc link. To generate  $P_{dc}$ , a suitable closed-loop dc-link voltage controller should be used, which will regulate the dc voltage to the reference value.


For the DSTATCOM compensating unbalanced and nonlinear loads, the transient performance of the compensator is decided by the computation time of average load power and losses in the compensator. The transient performance of the compensator mostly depends on the computation of  $P_{lavg}$ , and is computed by using a moving average filter to ensure fast dynamic response. Although the computation of  $P_{dc}$  is generally slow and updated once or twice in a cycle, being a small value compared to  $P_{lavg}$ , it does not play a significant role in transient performance of the compensator. In some of the electric power consumers, such as the telecommunications industry, power-electronics drive applications, etc., there is a requirement for ac as well as dc loads. The telecommunication industry uses several parallel-connected switch-mode rectifiers to support dc bus voltage. Such an arrangement draws nonlinear load currents from the utility. This causes poor power factor and, hence, more losses and less efficiency. Clearly, there are PQ issues, such as unbalance, poor power factor, and harmonics produced by telecom equipment in power distribution networks. Therefore, the functionalities of the conventional DSTATCOM should be increased to mitigate the aforementioned PQ problems and to supply the dc loads from its dc link as well. The load sharing by the ac and dc bus depends upon the design and the rating of the VSI. This DSTATCOM differs from conventional one in the sense that its dc link not only supports instantaneous compensation but also supplies dc loads. However, when the dc link of the DSTATCOM supplies the dc load as well, the corresponding dc power is comparable to the average load power and, hence, plays a major role in the transient response of the compensator. Hence, there are two important issues. The first one is the regulation of the dc-link voltage within prescribed limits under transient load conditions. The second one is the settling time of the dc-link voltage controller. Conventionally, a PI controller is used to maintain the dc-link voltage. In this paper, a fast-acting dc-link voltage controller based on the dc-link capacitor energy is proposed

# YUYAENGINEERS

Transforming Young Engineers for Better Tomorrow

## II. DSTATCOM FOR COMPENSATING AC AND DC LOADS:

Various VSI topologies are described in the literature for realizing DSTATCOM to compensate unbalanced and nonlinear loads. Due to the simplicity, the absence of unbalance in the dc-link voltage and independent current tracking with respect to other phases, a three-phase H-bridge VSI topology is chosen. Fig.1 shows a three-phase, four-wire-compensated system using an H-bridge VSI topology-based DSTATCOM compensating unbalanced and nonlinear ac load. In addition to this, a dc load ( $R_{dc}$ ) is connected across the dc link. The DSTATCOM consists of 12 insulated-gate bipolar transistor (IGBT) switches each with an antiparallel diode, dc storage capacitor, three isolation transformers, and three interface inductors. The star point of the isolation transformers ( $n'$ ) is connected to the neutral of load ( $n$ ) and source ( $N$ ). The H-bridge VSIs are connected to the PCC through interface inductors. The isolation transformers prevent a short circuit of the dc capacitor for various combinations of the switching states of the VSI. The inductance and resistance of the isolation transformers are also included in  $L_f$  and  $R_f$ . The source voltages are assumed to be balanced and sinusoidal. With the supply being considered as a stiff source, the feeder impedance ( $L_f - R_f$ ) shown in Fig. 1 is negligible and, hence, it is not accounted in state-space modeling.

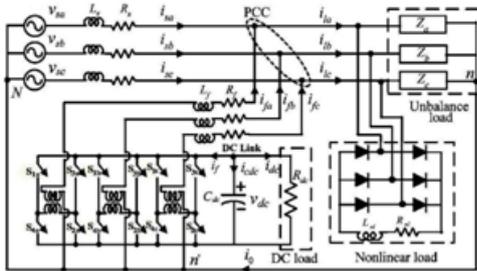

**Fig.1. Three-phase, four-wire compensated system using the H-bridge VSI topology-based DSTATCOM.**

To track the desired compensator currents, the VSIs operate under the hysteresis band current control mode due to their simplicity, fast response, and being independent of the load parameters.

The DSTATCOM injects currents into the PCC in such a way as to cancel unbalance and harmonics in the load currents. The VSI operation is supported by the dc storage capacitor  $C_{dc}$  with voltage  $v_{dc}$  across it. While compensating, the DSTATCOM maintains the balanced sinusoidal source currents with unity power factor and supplies the dc load through its dc bus.

## III. STATE-SPACE MODEL OF THE DSTATCOM:

For the DSTATCOM topology shown in Fig.1, the pairs of switches  $S_{1a}-S_{2a}$  and  $S_{4a}-S_{3a}$  are always ON and OFF in complimentary mode. The ON and OFF states of these switches are represented by a binary logic variable  $S_a$  and its complement  $\bar{S}_a$ . Thus, when switches  $S_{1a}-S_{2a}$  are ON, it implies that switches  $S_{4a}-S_{3a}$  are OFF. This is represented by  $S_a = 1$ ,  $\bar{S}_a = 0$ , and vice versa. In a similar way,  $S_b, \bar{S}_b, S_c$  and  $\bar{S}_c$  represent gating signals for switches  $S_{1b}-S_{2b}, S_{4b}-S_{3b}, S_{1c}-S_{2c}, S_{4c}-S_{3c}$  respectively. Using these notations for the system shown in Fig.1, the state-space equations are written as follows:

$$\dot{\mathbf{x}} = \mathbf{A}\mathbf{x} + \mathbf{B}\mathbf{u} \quad (2)$$

Where, state vector  $\mathbf{x}$  and input vector  $\mathbf{u}$  are given by

$$\mathbf{x} = [i_{fa} \quad i_{fb} \quad i_{fc} \quad v_{dc}]^T \quad (3)$$

$$\mathbf{u} = [v_{sa} \quad v_{sb} \quad v_{sc}]^T \quad (4)$$

Where, the superscript  $\Gamma$  stands for the transpose operator. System matrix ( $\mathbf{A}$ ) and input matrix ( $\mathbf{B}$ ) are given as follows:

$$\mathbf{A} = \begin{bmatrix} -\frac{R_f}{L_f} & 0 & 0 & \frac{(S_a - \bar{S}_a)}{L_f} \\ 0 & -\frac{R_f}{L_f} & 0 & \frac{(S_b - \bar{S}_b)}{L_f} \\ 0 & 0 & -\frac{R_f}{L_f} & \frac{(S_c - \bar{S}_c)}{L_f} \\ -\frac{(S_a - \bar{S}_a)}{C_{dc}} & -\frac{(S_b - \bar{S}_b)}{C_{dc}} & -\frac{(S_c - \bar{S}_c)}{C_{dc}} & \frac{1}{R_{dc}C_{dc}} \end{bmatrix} \quad (5)$$

$$\mathbf{B} = \begin{bmatrix} \frac{1}{L_f} & 0 & 0 \\ 0 & \frac{1}{L_f} & 0 \\ 0 & 0 & \frac{1}{L_f} \\ 0 & 0 & 0 \end{bmatrix} \quad (6)$$

# YUVAENGINEERS

Transforming Young Engineers for Better Tomorrow

Using the above state-space model, the system state variables ( $\mathbf{x}$ ) are computed at every instant.

#### IV. DC-LINK VOLTAGE CONTROLLERS:

As mentioned before, the source supplies an unbalanced nonlinear ac load directly and a dc load through the dc link of the DSTATCOM, as shown in Fig. 1. Due to transients on the load side, the dc bus voltage is significantly affected. To regulate this dc-link voltage, closed-loop controllers are used. The proportional-integral-derivative (PID) control provides a generic and efficient solution to many control problems. The control signal from PID controller to regulate dc link voltage is expressed as

$$u_c = K_p(V_{dc\ ref} - v_{dc}) + K_i \int (V_{dc\ ref} - v_{dc}) dt + K_d d(V_{dc\ ref} - v_{dc})/dt \quad (7)$$

$K_p$ ,  $K_i$ , and  $K_d$  are proportional, integral, and derivative gains of the PID controller, respectively. The proportional term provides overall control action proportional to the error signal. An increase in proportional controller gain ( $K_p$ ) reduces rise time and steady-state error but increases the overshoot and settling time. An increase in integral gain ( $K_i$ ) reduces steady-state error but increases overshoot and settling time. Increasing derivative gain ( $K_d$ ) will lead to improved stability.

#### A. Conventional DC-Link Voltage Controller:

The conventional PI controller used for maintaining the dc-link voltage is shown in Fig. 2. To maintain the dc-link voltage at the reference value, the dc-link capacitor needs a certain amount of real power, which is proportional to the difference between the actual and reference voltages. The dc-link capacitor has slow dynamics compared to the compensator, since the capacitor voltage is sampled at every zero crossing of phase a supply voltage. The sampling can also be performed at a quarter-cycle depending upon the symmetry of the dc-link voltage waveform. The power required by the capacitor can be expressed as :

$$P_{dc} = K_p(V_{dc\ ref} - v_{dc}) + K_i \int (V_{dc\ ref} - v_{dc}) dt \quad (8)$$




Fig.2. Schematic diagram of the conventional dc-link voltage controller.




Fig.3. Schematic diagram of the fast-acting dc-link voltage controller.

The drawback of this conventional controller is that its transient response is slow, especially for fast-changing loads. Also, the design of PI controller parameters is quite difficult for a complex system and, hence, these parameters are chosen by trial and error. Moreover, the dynamic response during the transients is totally dependent on the values of  $K_p$  and  $K_i$  when  $P_{dc}$  is comparable to  $P_{lavg}$ .

#### B. Fast-Acting DC-Link Voltage Controller:

To overcome the disadvantages of the aforementioned controller, an energy-based dc-link voltage controller is proposed. The energy required by the dc-link capacitor ( $W_{dc}$ ) to charge from actual voltage ( $v_{dc}$ ) to the reference value ( $V_{dc\ ref}$ ) can be computed as

$$W_{dc} = \frac{1}{2} C_{dc} (V_{dc\ ref}^2 - v_{dc}^2) \quad (9)$$

In general, the dc-link capacitor voltage has ripples with double frequency, that of the supply frequency. The dc power ( $P'_{dc}$ ) required by the dc-link capacitor is given as

$$P'_{dc} = \frac{W_{dc}}{T_c} = \frac{1}{2T_c} C_{dc} (V_{dc\ ref}^2 - v_{dc}^2) \quad (10)$$

where  $T_c$  is the ripple period of the dc-link capacitor voltage. However, due to the lack of integral term, there is a steady-state error while compensating the combined ac and dc loads. This is eliminated by including an integral term. The input to this controller is the error between the squares of reference and the actual capacitor voltages.

# YUVAENGINEERS

Transforming Young Engineers for Better Tomorrow

This controller is shown in Fig.3 and the total dc power required by the dc-link capacitor is computed as follows:

$$P_{dc} = K_{pe} (V_{dc\ ref}^2 - v_{dc}^2) + K_{ie} \int (V_{dc\ ref}^2 - v_{dc}^2) dt \quad (11)$$

$$K_{pe} = \frac{C_{dc}}{2T_c} \quad (12)$$

The coefficients  $K_{pe}$  and  $K_{ie}$  are the proportional and integral gains of the proposed energy-based dc-link voltage controller. As an energy-based controller, it gives fast response compared to the conventional PI controller. Thus, it can be called a fastacting dc-link voltage controller. For example, if the value of dc-link capacitor is  $2200\mu F$  and the capacitor voltage ripple period as 0.01 s, then  $K_{pe}$  is computed as 0.11 by using (12). The selection of  $K_{ie}$  depends upon the tradeoff between the transient response and overshoot in the compensated source current. Once this proportional gain is selected, integral gain is tuned around and chosen to be 0.5. It is found that if  $K_{ie}$  is greater than  $K_{pe}/2$ , the response tends to be oscillatory and if  $K_{ie}$  is less than  $K_{pe}/2$ , then response tends to be sluggish. Hence,  $K_{ie}$  is chosen to be  $K_{pe}/2$ .

## V. CONVENTIONAL CONTROLLER BASED ON THE FAST-ACTING DC-LINK

The conventional dc-link voltage controller can be designed based on equations given for the fast acting dc-link voltage controller as in (11) and can be written

$$\text{as } P_{dc} = K_{pe} (V_{dc\ ref} - v_{dc})(V_{dc\ ref} + v_{dc}) + K_{ie} \int (V_{dc\ ref} - v_{dc})(V_{dc\ ref} + v_{dc}) dt \quad (13)$$

It can be also written as

$$P_{dc} = K'_p (V_{dc\ ref} - v_{dc}) + K'_i \int (V_{dc\ ref} - v_{dc}) dt \quad (14)$$

Where

$$K'_p = K_{pe} (V_{dc\ ref} + v_{dc}) \quad (15)$$

$$K'_i = K_{ie} (V_{dc\ ref} + v_{dc}) \quad (16)$$

It is observed from the aforementioned equations that the gains of proportional and integral controllers vary with respect to time. However, for small ripples in the dc-link voltage,  $v_{dc} \approx V_{dc\ ref}$ , therefore, we can approximate the above gains to the following:

$$K'_p \approx 2K_{pe} V_{dc\ ref} \quad (17)$$

$$K'_i \approx 2K_{ie} V_{dc\ ref} \quad (18)$$

The relations (17)–(18) give approximate gains for a conventional PI controller. This is due to the fact that  $V_{dc\ ref} + v_{dc}$  is not really equal to  $2V_{dc\ ref}$  until variation in  $v_{dc}$  is small during transients. Hence, the designed conventional PI controller works only on approximation. The open-loop gains for the two cases are given by

$$\frac{P_{dc}}{E_{er}} = \frac{K_{pe} (s + K_{ie}/K_{pe})}{s} \quad (19)$$

Where  $E_{er} = V_{dc\ ref}^2 - v_{dc}^2$  and

$$\frac{P_{dc}}{E_r} = \frac{K'_p (s + K'_i/K'_p)}{s} \quad (20)$$

# YUVAENGINEERS

Transforming Young Engineers for Better Tomorrow

**TABLE I: SIMULATION PARAMETERS**

System Parameters	Values
Supply voltage	400 V (L-L), 50 Hz
Unbalanced load	$Z_a=25\Omega$ , $Z_b=44+j25.5\Omega$ and $Z_c=50+j86.6\Omega$
Nonlinear load	3 $\emptyset$ full wave rectifier drawing a dc current of 5A
DC load	$R_{dc} = 100 \Omega$
DC capacitor	$C_{dc} = 2000\mu F$
Interface inductor	$L_f = 26 \text{ mH}$ , $R_f = 0.25 \Omega$
Reference DC link voltage	$V_{dc \text{ ref}} = 520V$
Hysteresis band	$\pm h = 1.0 \text{ A}$
Gains of conventional DC link voltage controller	$K_p = 40$ , $K_i = 20$
Gains of fast-acting DC link voltage controller	$K_p = 0.11$ , $K_i = 0.055$

where,  $E_r = V_{dc \text{ ref}} - v_{dc}$ . Since  $K'_i/K'_p$  is the same as  $K_{ie}/K_{pe}$ , the higher gain in the conventional PI controller renders less stability than that of the proposed energy-based dc-link controller. For nearly the same performance, the conventional PI controller has gains which are 364 (40/0.11 from Table I) times larger than that of that proposed one. Also, the amplifier units used to realize these gains need more design considerations and are likely to saturate when used with higher gains.

## VI. SELECTION OF THE DC-LINK CAPACITOR:

The value of the dc-link capacitor can be selected based on its ability to regulate the voltage under transient conditions. Let us assume that the compensator in Fig. 1 is connected to a system with the rating of X kilovolt amperes. The energy of the system is given by  $X \times J/s$ . Let us further assume that the compensator deals with half (i.e.,  $X/2$ ) and twice (i.e.,  $2X$ ) capacity under the transient conditions for n cycles with the system voltage period of T s.

Then, the change in energy to be dealt with by the dc capacitor is given as

$$\Delta E = (2X - X/2)nT \quad (21)$$

Now this change in energy (21) should be supported by the energy stored in the dc capacitor. Let us allow the dc capacitor to change its total dc-link voltage from 1.4 to 1.8 during the transient conditions where is the peak value of phase voltage. Hence, we can write

$$\frac{1}{2} C_{dc} [(1.8V_m)^2 - (1.4V_m)^2] = (2X - X/2)nT \quad (22)$$

which implies that

$$C_{dc} = \frac{3XnT}{(1.8V_m)^2 - (1.4V_m)^2} \quad (23)$$


For example, consider a 10-kVA system (i.e.,  $X=10\text{kVA}$ ), system peak voltage  $V_m = 325.2 \text{ V}$ ,  $n=0.5$ , and  $T=0.02 \text{ s}$ . The value of  $C_{dc}$  computed using (23) is  $2216\mu F$ . Practically,  $2000\mu F$  is readily available and the same value has been taken for simulation and experimental studies.

## VII. SIMULATION STUDIES:

The load compensator with H-bridge VSI topology as shown in Fig.1 is realized by digital simulation by using MATLAB. The load and the compensator are connected at the PCC. The ac load consists of a three-phase unbalanced load and a three-phase diode bridge rectifier feeding a highly inductive R-L load. A dc load is realized by an equivalent resistance ( $R_{dc}$ ) as shown in the figure. The dc load forms 50% of the total power requirement. By monitoring the load currents and PCC voltages, the average load power is computed. At every zero crossing of phase a voltage,  $P_{dc}$  is generated by using the dc-link voltage controller. The transient performance of the conventional and fast-acting dc-link voltage controllers are studied by making sudden changes in the ac load supplied by the ac load bus as well as the dc load supplied by the dc link. In the simulation study, the load is halved at the instant  $t=0.4 \text{ s}$  and brought back to full load at  $t=0.8 \text{ s}$ .

# YUVAENGINEERS

Transforming Young Engineers for Better Tomorrow

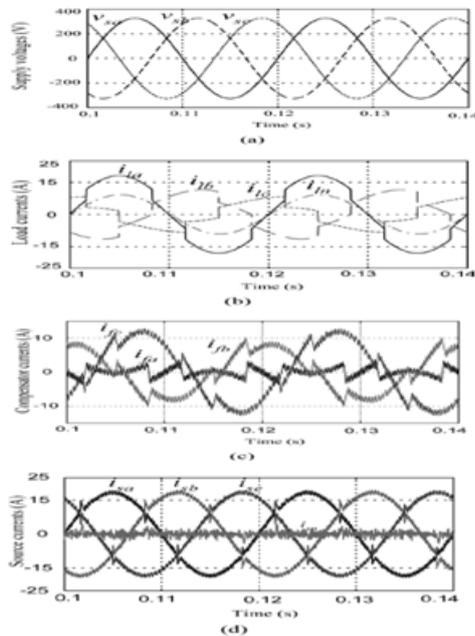

**Fig. 4. (a) Supply voltages. (b) Load currents. (c) Compensator currents. (d) Compensated source currents.**


## A. Transient Response of Conventional DC-Link Voltage Controller

The conventional dc-link voltage controller as given in (8) is used to generate the dc load power  $P_{dc}$  which is inclusive of losses in the inverter. The total load, which is a combination of linear unbalanced and nonlinear load, is halved at the instant  $t = 0.4$  s. Due to a sudden reduction in the load, the dc-link capacitor absorbs surplus power from the source. Therefore, there is an increase in dc link capacitor voltage above the reference value. Based on the values of PI controller gains, the dc-link of PI controller gains, the dc-link capacitor voltage controller will be brought back to the reference value after a few cycles. Similarly, when the load is switched back to the full load at instant  $t = 0.8$  s, the dc capacitor supplies power to the load momentarily and, hence, the dc-link voltage falls below the reference value. Due to the PI controller action, the capacitor voltage will gradually build up and reach its reference value. If gains of the conventional dc-link voltage controller are not properly chosen, the dc-link voltage would have undesirable overshoot and considerably large settling


time. Consequently, the performance of the load connected to the dc link also gets affected due to the above factors. The conventional dc-link voltage controller takes about a ten cycle period to reach the reference voltage during load transient. This is indicated by time duration  $t_s$  in these figures.

## B. Transient Response of Fast-Acting DC-Link Voltage Controller

The dc load power  $P_{dc}$  is computed by using the fast-acting dc-link voltage controller as given in (11). Fig. 6(a) and (b) illustrates the phase a source current and dc-link capacitor voltage during the load transients. At the instant  $t = 0.4$  s, the capacitor voltage increases due to the sudden removal of the load.

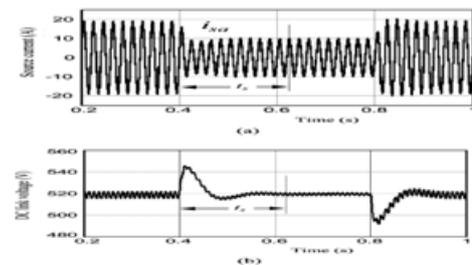

**Fig. 5. Transient response of the conventional controller. (a) Compensated source current in phase a. (b) DC-link voltage.**

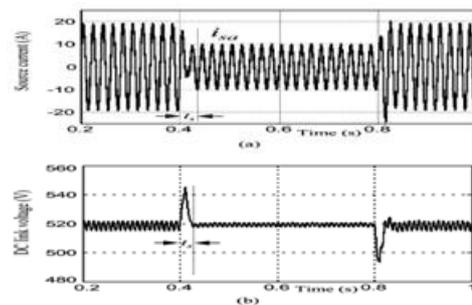

**Fig. 6. Transient response of the fast-acting controller. (a) Compensated source current in phase a. (b) DC-link voltage.**

The fast-acting dc-link voltage controller takes action at the instant  $t = 0.41$  s. This is because the controller output is updated at every half cycle. It computes the dc load power  $P_{dc}$  needed to bring the capacitor voltage to the reference value in a half cycle.

# YUVAENGINEERS

Transforming Young Engineers for Better Tomorrow

Therefore, the dc-link voltage reaches its reference voltage at the instant  $t=0.42$  s. When the dc-link voltage is more than the reference value,  $P_{dc}$  is less. Therefore, the source currents are less in magnitude. At the instant 0.8 s, the dc-link voltage falls below the reference value due to a sudden increase in load reference value at  $t=0.82$  s with almost the same rise in voltage as that of the conventional dc-link voltage controller. A close observation of the figure would reveal that the fast-acting dc-link voltage controller can regulate the capacitor voltage within a half cycle period which is indicated by  $t_s$ . Owing to its good transient performance, it is preferred over the conventional dc link voltage controller.

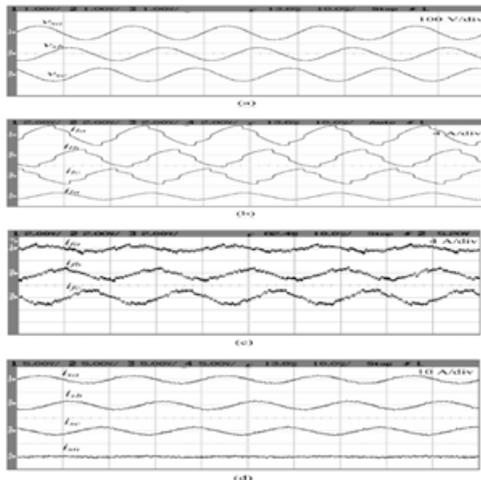


Fig. 7. (a) Supply voltages. (b) Load currents. (c) Compensator currents. (d) Source currents after compensation.

In conventional control, at an instant  $t = t_1$ , the unbalanced linear R-L load and a half dc load are removed. At  $t = t_2$ , the load is brought to its original value. The use of the conventional controller with an improper value of controller gains cannot bring the actual dc-link voltage to its reference value quickly. It takes around 40 cycles to regulate the dc-link voltage to its reference voltage. The response time of the fast-acting dc-link voltage controller is very less compared to that of the conventional dc-link voltage controller. Though, in simulation studies, the fast-acting voltage controller corrects the actual dc-link voltage in a half cycle, the experimental results do not fully validate the

same. This is due to the use of the mechanical switch for the change of load, which cannot connect/disconnect the load in all three phases simultaneously at the instants  $t_1$  and  $t_2$ , and due to other non-idealities in the system.

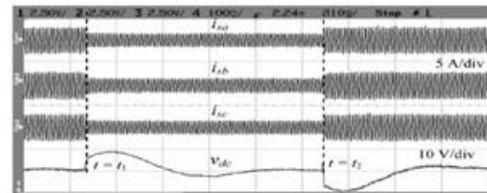


Fig. 8. Source currents and dc-link voltage with a conventional dc link voltage controller.

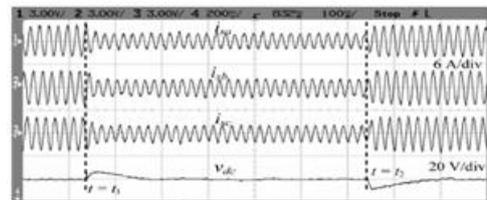


Fig. 8. Source currents and dc-link voltage with a fast-acting dc-link voltage controller.

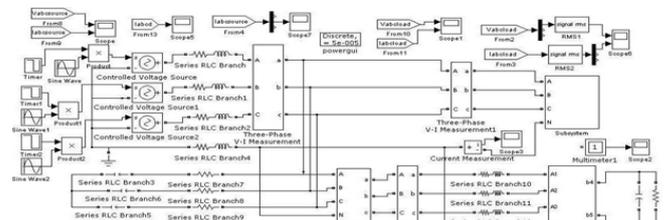


Fig-9: Simulink model for Three-phase Dstatcom to compensate Ac Unbalanced, Nonlinear loads and Dc loads


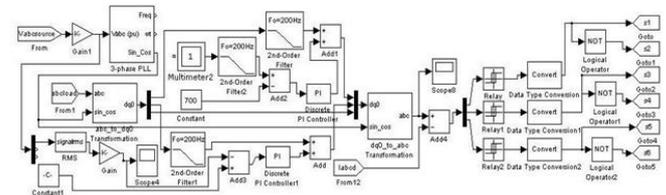


Fig-10(a): A conventional dc-link voltage controller for Three-phase Dstatcom

# YUVAENGINEERS

Transforming Young Engineers for Better Tomorrow

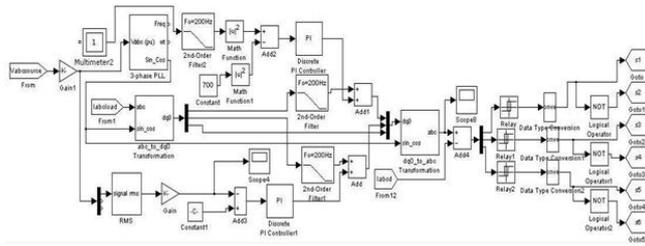

**Fig-10(b): A fast-acting (Energy-based) dc-link voltage controller for Three-phase Dstatcom**

## VIII. CONCLUSION:

A VSI topology for DSTATCOM compensating ac unbalanced and nonlinear loads and a dc load supplied by the dc link of the compensator is presented. The state-space modeling of the DSTATCOM is discussed for carrying out the simulation studies. An energy-based fast-acting dc-link voltage controller is suggested to ensure the fast transient response of the compensator. Mathematical equations are developed to compute the gains of this controller. The efficacy of the proposed controller over the conventional dc-link voltage controller is established through the digital simulation and experimental studies. It is observed from these studies that the proposed dc-link voltage controller gives fast transient response under load transients.

## REFERENCES:

- [1] M. H. J. Bollen, Understanding Power Quality Problems: Voltage Sags and Interruptions. New York: IEEE Press, 1999.
- [2] W. M. Grady and S. Santoso, Proc. IEEE Power Eng. Rev. Understanding Power System Harmonics, vol. 21, no. 11, pp. 8–11, 2001.
- [3] N. Hingorani, “Introducing custom power,” IEEE Spectr., vol. 32, no. 6, pp. 41–48, Jun. 1995.
- [4] A. Ghosh and G. Ledwich, Power Quality Enhancement Using Custom Power Devices. Norwell, MA: Kluwer, 2002.
- [5] V. Dinavahi, R. Iravani, and R. Bonert, “Design of a real-time digital simulator for a D-STATCOM

system,” IEEE Trans. Ind. Electron., vol. 51, no. 5, pp. 1001–1008, Oct. 2004.

- [6] D. Vilathgamuwa, H. M. Wijekoon, and S. S. Choi, “A novel technique to compensate voltage sags in multilined distribution system and the interline dynamic voltage restorer,” IEEE Trans. Ind. Electron., vol. 55, no. 5, pp. 1603–1611, Oct. 2006.